





# URINAL SENSOR UNIT

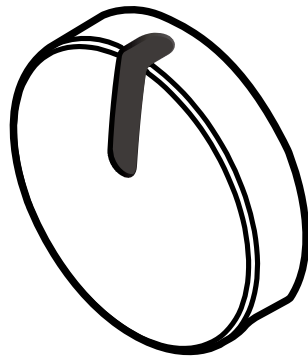


**A**



**B**



**C**

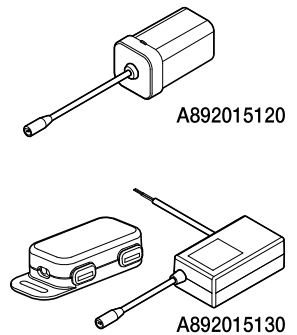

**D**




**E**



**F**



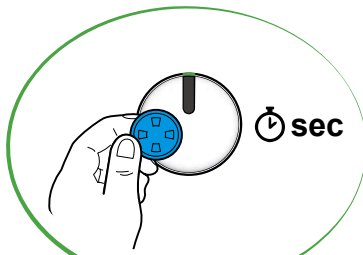

**Approach the magnet for adjustment and remove in desired time range**



**1-5 s**  
CLEAN




**5-10 s**  
FLUSH MODE





**10-15 s**  
DISTANCE




**15-20 s**  
FLUSH TIME



CLEAN




60 sec






FLUSH MODE

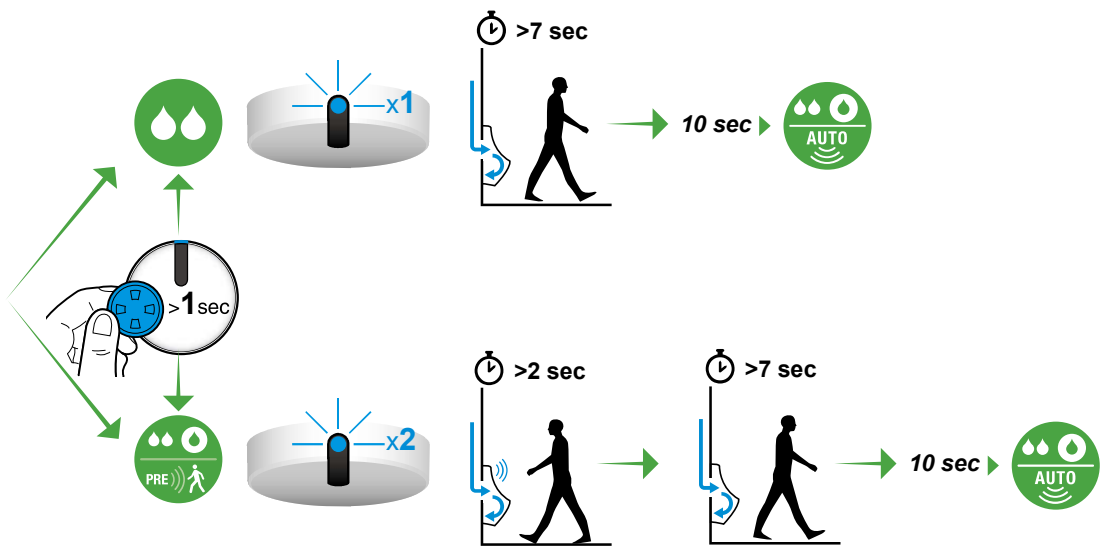

DISTANCE

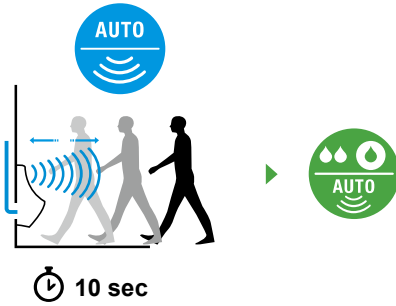

FLUSH TIME

